



# Metal Roof Certification & Listing Program

## Certification Report



11030-002-KCI

145 Limekiln Road, Suite 100B  
New Cumberland, PA 17070  
[www.keystonecerts.com](http://www.keystonecerts.com)

Issue Dated: 11/29/2017  
Revision Date: 11/29/2017  
Expiration Date: 11/29/2022

### Construction Specifications Institute (CSI) Category:

**Division:** 07 00 00 – Thermal & Moisture Protection

**Section:** 07 41 13 – Metal Roof Panels

### 1. Program Licensee:



Reed's Metals, Inc.  
19 E. Lincoln Drive NE  
Brookhaven, Mississippi 39601  
800-581-4645  
<https://reedsmetals.com/>

### 2. Certified Roof Covering:

Reeds Metals Model PBR Panel non-structural through-fastened minimum 26 gauge metal roof panels installed over nominal 15/32" plywood sheathing roof deck for use in new construction and re-roofing applications.

### 3. Scope of Certification:

This Certification Report provides technical data substantiating that the use of the certified roof covering and the evaluated roof systems are in compliance with the following:

- 2017 Florida Building Code - Building, 6th Edition, Section 1504.3.2.
- Florida Product Approval Rule 61G20-3.

Properties Evaluated:

- Wind Uplift Resistance

### 4. Evaluated Roof System Description:

4.1. **Roof Covering:** PBR Panel metal roof covering panels are cold roll-formed from minimum 26 gauge (0.020" / 0.508mm coated thickness) Grade 80 steel sheet. The panels are aluminum-zinc alloy coated per ASTM A792 (AZ50) and shall be installed in accordance with the manufacturer's instructions and this Certification Report.

4.2. **Roof Deck:** PBR Panel metal roof panels are certified for use over solid or closely-spaced, nominal 15/32" plywood sheathing complying with 2017 Florida Building Code, Section 2303.1.5 with a minimum slope of 4% (1/2:12).

4.3. **Anchorage:** PBR Panel metal roof panels shall be through-fastened to the roof deck using #9-15 x 1-1/2" SFS Intec Woodgrip HWH with EPDM-sealing washer or approved equivalent, as specified in Table 1, applied in the patterns described in Appendix 1.

### 5. Installation

PBR Panel metal roof panels in new construction applications shall be installed in accordance with the 2017 Florida Building Code Section 1507.4, the manufacturer's published installation instructions and this Certification Report.

PBR Panel metal roof panels in re-roofing applications shall be installed in accordance with the 2017 Florida Building Code Sections 1507.4 & 1511, the manufacturer's published installation instructions and this Certification Report.



**Metal Roof Certification & Listing Program**  
**Certification Report**  
 11030-001-KCI



The manufacturer’s installation instructions shall be made available at the time of installation. If there are differences between this report and the manufacturer’s installation instructions, this report shall take precedence.

**6. Product Performance**

The performance of the PBR Panel non-structural through-fastened metal roof panels described in this Certification Report has been determined in accordance with:

- UL 580-06, *Tests for Uplift Resistance of Roof Assemblies.*
- UL 1897-2012, *Uplift Tests for Roof Covering Systems.*

As tested & reported by the following independent accredited laboratory:

| Laboratory                  | Report Ref.       |
|-----------------------------|-------------------|
| Force Engineering & Testing | 101-0211T-17A & B |

**6.1. Wind Resistance**

The allowable design uplift pressures for PBR Panel anchored as described in Appendix 1, when tested in accordance with the referenced standards with an applied safety factor of 2.0 are found in Table 1.

**Table 1**

| Description                      | Anchor Pattern                          | Max Design Uplift Pressure |
|----------------------------------|---|----------------------------|
| Over 15/32"<br>Plywood Sheathing | <b>A</b><br>12"-12"-12",<br>24" O.C.    | <b>-56.0 psf</b>           |
| Over 15/32"<br>Plywood Sheathing | <b>B</b><br>7"-5"-7"-5"-7",<br>12" O.C. | <b>-146.0 psf</b>          |

**7. Conditions of Use**

PBR Panel non-structural through-fastened metal roof panels must be insulated against other materials or metals including concrete, lead, copper and treated lumber that contains corrosive materials.

**8. Limitations of Use**

PBR Panel non-structural through-fastened metal roof panels are not qualified for use in the High Velocity Hurricane Zone (HVHZ).

Fire classification, shear diaphragm design, roof deck design & attachment to supporting members are not within the scope of this Certification Report.

Roof support framing shall comply with 2017 Florida Building Code Chapter 22 for steel, Chapter 23 for wood and Chapter 16 for structural loading.



# Metal Roof Certification & Listing Program Certification Report 11030-001-KCI



## 9. Licensed Manufacturing Facilities

This Certification Report is applicable only to PBR Panel non-structural through-fastened metal roof panels manufactured at the following locations:

|  |
|--|
| <p>Reed's Metals, Inc.<br/>19 E. Lincoln Drive NE<br/>Brookhaven, Mississippi 39601</p> <p>Reeds Metals Inc.<br/>16454 SE Highway 19<br/>Cross City, Florida 32628</p> |
|--|

Aaron Shultz  
Validations Manager

Each licensed facility is subject to periodic inspection by Keystone Certifications to verify conformance with Keystone Roof Covering Certification & Listing Program requirements.

## 10. Identification


PBR Panel non-structural through-fastened metal roof panels represented by this report shall be identified with Keystone Roof Covering Certification & Listing Program certification labeling illustrated below, to be applied to individual panels, packaging, invoicing or bills of lading:




## Appendix 1

Notes: In all cases (new construction and re-roofing), the anchors shall fully penetrate the plywood roof deck.  
 Lap sealant is required for slopes less than 3:12.

### Anchor Pattern A

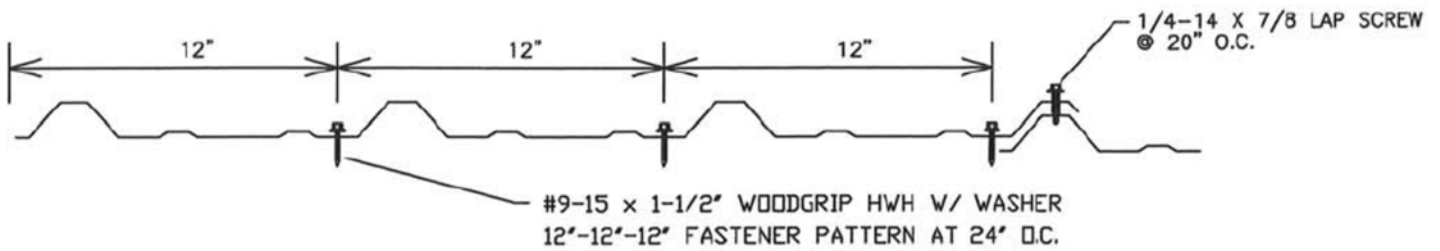

### Anchor Pattern B

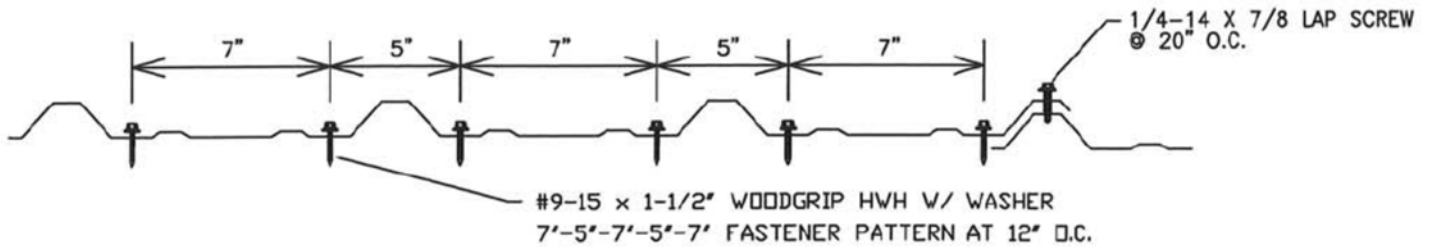



Metal Roof Certification & Listing Program

**Certification Report**

11030-002-KCI



145 Limekiln Road, Suite 100B  
New Cumberland, PA 17070  
[www.keystonecerts.com](http://www.keystonecerts.com)

Issue Dated: 11/29/2017  
Revision Date: 11/29/2017  
Expiration Date: 11/29/2022

**Certificate Revisions**

| Rev # | Date       | Description       |
|-------|------------|-------------------|
| 0     | 11/29/2017 | Initial issuance. |